


| ZONE | Wall Mounted Switch 230 V | Light 230 V | Pull Cord Switch Mechanism | Insulating Pull Cord | SELV Light | SELV Transformer | Shaver Supply Unit | Fixed Fan 230 V | Fixed Fan SELV | Shower Pump | Water Heater | Other Fixed Equipment |
|---------|---------------------------|-------------|----------------------------|----------------------|------------|------------------|--------------------|-----------------|----------------|-------------|--------------|-----------------------|
| 0 | X | X | X | X | Note 1 | X | X | X | X | X | X | X |
| 1 | X | Note 2 | X | | Note 3 | X | X | Note 2 | Note 3 | Note 3 | Note 3 | Note 2 |
| 2 | X | Note 3 | X | | Note 3 | X | Note 4 | Note 3 | Note 3 | Note 3 | Note 3 | Note 3 |
| 3 | | | | | | | Note 4 | | | | | |
| OUTSIDE | | | | | | | | | | | | |

NOTES (also see notes overleaf)

- 1 12 Volt only and must be IPX7
- 2 Not able to be located elsewhere and must be 30mA RCD protected and IPX4 (IPX5 if hosing down)
- 3 IPX4 level of protection required (IPX5 if hosing down)
- 4 Shaver supply unit, complying with BS EN 60742 Chapter 2, Section 1



GUIDE TO SITING EQUIPMENT IN A LOCATION CONTAINING A BATH

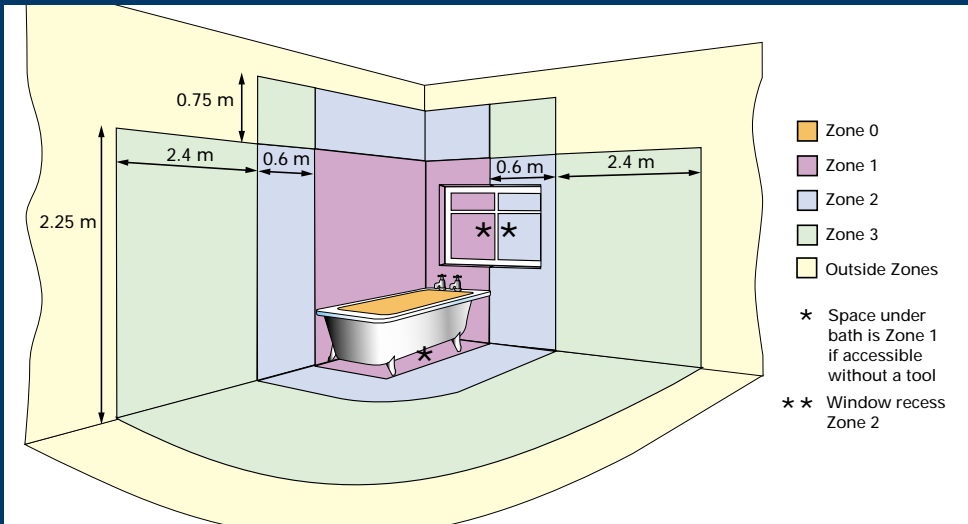

Notes (also see notes overleaf)

- (i) This guide applies only to a typical domestic bathroom. It is not intended to replace Section 601 of BS 7671.
- (ii) Reference should be made to Section 601 for details of any installation in a location containing a bath or a shower.
- (iii) Local supplementary bonding is required to connect together the terminal of the protective conductor of each circuit supplying Class I and Class II equipment in zones 1, 2 or 3, and extraneous-conductive-parts in these zones.
- (iv) All equipment to be suitable for the zone where it is installed.
- (v) LV socket-outlets not permitted, except for a shaver supply unit.
- (vi) Except for shavers, portable LV equipment is not permitted.



NICEIC

Warwick House, Houghton Hall Park, Houghton Regis, Dunstable LU5 5ZX
Tel: 01582 539000 Fax: 01582 539090

For further copies of this guide contact NICEIC
Sales by telephoning 0870 0130458 or e-mailing
sales@niceic.org.uk